



Cement Mill Test Report

Date of Issue: July 15, 2024

Plant: Exshaw AB
 Product: Portland Cement Type I/II
 Mill Test Report Number: ESW_Type I-II 2024-6
 Manufactured during the month of: June 2024

ASTM C 150-22 and AASHTO M 85-22 Standard Requirements

CHEMICAL ANALYSIS			PHYSICAL ANALYSIS		
Item	Spec limit	Test Result	Item	Spec limit	Test Result
Rapid Method, X-Ray (C114)			Air content of mortar (%) (C185)	12 max	6
SiO ₂ (%)	---	19.2	Blaine Fineness (m ² /kg) (C204)	260 min	421
Al ₂ O ₃ (%)	6.0 max	4.4	Passing 45 μm (%) (C430)	---	98.1
Fe ₂ O ₃ (%)	6.0 max	3.2	Compressive strength (MPa, [psi]) (C 109)		
CaO (%)	---	61.9	3 days	12.0 [1740] min	28.8 [4175]
MgO (%)	6.0 max	4.6	7 days	19.0 [2760] min	36.3 [5260]
SO ₃ (%)*	3.0 max *	3.1	28 days (Previous Month's Result)		45.8 [6645]
Loss on Ignition (%)	3.5 max	2.7	Time of setting (minutes)		
Insoluble Residue (%)	1.5 max	0.3	Vicat Initial (C191)	45 - 375	80
CO ₂ (%)	---	1.8	Mortar Bar Expansion (%) (C1038)**	0.020 max	0.010
Limestone (%)	5.0 max	4.3			
CaCO ₃ in Limestone (%)	70 min	96.0			
Inorganic Process Addition (Lafarge Cement Kiln Dust)	5.0 max				
Adjusted Potential Phase Composition (C50)					
C ₃ S (%)	---	56			
C ₂ S (%)	---	12			
C ₃ A (%)	8 max	6			
C ₄ AF (%)	---	10			
C ₃ S+4.75*C ₃ A (%)	100 max	85			

ASTM C 150-17 and AASHTO M 85-17 Optional Requirements:

Na ₂ O _{eq}	0.60 max	0.56	False set (%) (C451)	50 min	86
---------------------------------	----------	------	----------------------	--------	----

* May exceed the SO₃ maximum based on C 1038 results of <0.020% expansion at 14 days.

** Latest available results.

We certify that the above described cement, at the time of shipment, meets the chemical and physical requirements of:

ASTM C 150-22 & AASHTO M 85-22 STANDARD SPECIFICATIONS FOR TYPES I / II CEMENTS; and

ASTM C 150-22 & AASHTO M 85-22 OPTIONAL CHEMICAL REQUIREMENTS FOR TYPES I / II LOW ALKALI CEMENT.

AASHTO Accreditation Exceptions: C430

Western Canada BU - Exshaw Plant
 P.O. Box 160, Highway 1A, Exshaw AB, T0L 2C0
 Phone: 403-673-3815

Certified By:


 John W Blair
 Quality Manager



Certified to
NSF/ANSI/CAN 61



AASHTO
ACCREDITED



Cement Mill Test Report

Date of Issue: July 15, 2024

Plant: Exshaw AB
Product: Portland Cement Type I/II
Mill Test Report Number: ESW_Type I-II 2024-6
Manufactured: June 2024

ASTM C 150-22 and AASHTO M 85-22 Standard Requirements

Additional Data

Item	Test Result	
	Limestone	Inorganic Process Addition Lafarge Cement Kiln Dust
Amount (%)	4.3	-
SiO ₂ (%)	2.3	n/a
Al ₂ O ₃ (%)	0.5	n/a
Fe ₂ O ₃ (%)	0.2	n/a
CaO (%)	49.1	n/a
SO ₃ (%)	0.1	n/a
CO ₂ (%)	42.3	n/a

Base Cement Phase Composition

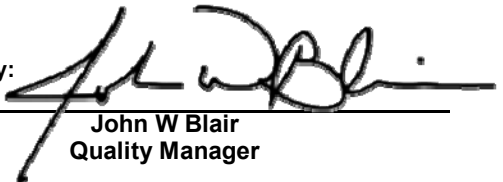
Item	Test Result
C ₃ S (%)	58
C ₂ S (%)	13
C ₃ A (%)	6
C ₄ AF (%)	10

Specific Gravity: 3.17 For information purposes only.

We certify that the data above reflects the materials used in cement manufacture during the production period indicated.

Western Canada BU - Exshaw Plant
P.O. Box 160, Highway 1A, Exshaw AB, T0L 2C0
Phone: 403-673-3815

Certified By:


John W Blair
Quality Manager